

# Autonics 8-PIN PLUG TYPE TIMER FSE SERIES INSTRUCTION MANUAL



Thank you for choosing our Autonics product.  
Please read the following safety considerations before use.

## Safety Considerations

※ Please observe all safety considerations for safe and proper product operation to avoid hazards.  
※ ⚠ symbol represents caution due to special circumstances in which hazards may occur.

**Warning** Failure to follow these instructions may result in serious injury or death.  
**Caution** Failure to follow these instructions may result in personal injury or product damage.

## Warning


- Fail-safe device must be installed when using the unit with machinery that may cause serious injury or substantial economic loss.** (e.g. nuclear power control, medical equipment, ships, vehicles, railways, aircraft, combustion apparatus, safety equipment, crime/disaster prevention devices, etc.)  
Failure to follow this instruction may result in fire, personal injury, or economic loss.
- Install on a device panel to use.**  
Failure to follow this instruction may result in electric shock or fire.
- Do not connect, repair, or inspect the unit while connected to a power source.**  
Failure to follow this instruction may result in electric shock or fire.
- Check 'Connections' before wiring.**  
Failure to follow this instruction may result in fire.
- Do not disassemble or modify the unit.**  
Failure to follow this instruction may result in electric shock or fire.

## Caution

- When connecting the power/sensor input and relay output, use AWG 20(0.50mm<sup>2</sup>) cable or over and tighten the terminal screw with a tightening torque of 0.74 to 0.90N·m.**  
Failure to follow this instruction may result in fire or malfunction due to contact failure.
- Use the unit within the rated specifications.**  
Failure to follow this instruction may result in fire or product damage.
- Use dry cloth to clean the unit, and do not use water or organic solvent.**  
Failure to follow this instruction may result in electric shock or fire.
- Do not use the unit in the place where flammable/explosive/corrosive gas, humidity, direct sunlight, radiant heat, vibration, impact, or salinity may be present.**  
Failure to follow this instruction may result in fire or explosion.
- Keep metal chip, dust, and wire residue from flowing into the unit.**  
Failure to follow this instruction may result in fire or product damage.

## Dimensions

(unit: mm)

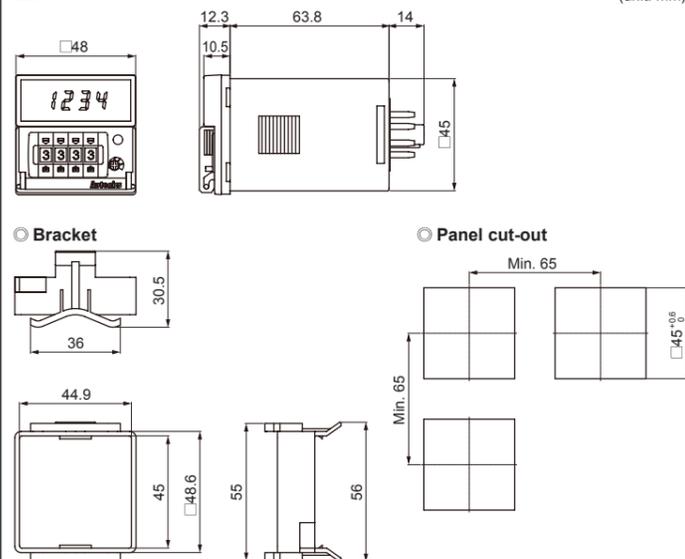

※ The above specifications are subject to change and some models may be discontinued without notice.  
※ Be sure to follow cautions written in the instruction manual and the technical descriptions (catalog, homepage).

## Model

Model	Display digit	Size	Output	Power supply
FS4E-1P2	9999 (4-digit)	DIN W48xH48mm	1-stage setting	24VAC 50/60Hz, 24-48VDC
FS4E-1P4	99999 (5-digit)			100-240VAC 50/60Hz
FS5E-14	99999 (5-digit)		Indicator	100-240VAC 50/60Hz


※ 8-pin socket (PG-08, PS-08(N)) is sold separately.

## Specifications


Model	FS4E-1P2	FS4E-1P4	FS5E-14
1-stage setting	—	—	—
Indicator	—	—	FS5E-14
Display digit	4-digit	—	5-digit
Character size (W×H)	3.8×7.6mm	—	4×8mm
Power supply	24VAC~50/60Hz, 24-48VDC	100-240VAC~50/60Hz	—
Permissible voltage range	90 to 110% of rated voltage		
Power consumption	Max. 3.5VA (24VAC~50/60Hz), Max. 2.3W (24-48VDC)	Max. 4.6VA (100-240VAC~50/60Hz)	Max. 3.8VA (100-240VAC~50/60Hz)
Return time	Max. 500ms		
Time operation	Power ON Start		
Min. signal width	RESET, INHIBIT: approx. 20ms		
Input method	Selectable voltage input (PNP) method or no-voltage input (NPN) method [Voltage input (PNP) method]-input impedance: max. 10.8kΩ, [H]: 5-30VDC, [L]: 0-2VDC [No-voltage input (NPN) method]-short-circuit impedance: max. 470Ω, short-circuit residual voltage: max. 1VDC, open-circuit impedance: min. 100kΩ		
One-shot output time	0.05 to 5 sec		
Control output	Time-limit SPDT (1c)	—	—
Relay life cycle	250VAC~3A, 30VDC= 3A resistive load		
Memory retention	Min. 5,000,000 operations		
Repeat error	Min. 100,000 operations (250VAC 3A resistive load)		
Set error	Approx. 10 years (non-volatile memory)		
Voltage error	Max. ±0.01% ±0.05 sec		
Temp. error	—		
Insulation resistance	Over 100MΩ (at 500VDC megger)		
Dielectric strength	2,000VAC 50/60Hz for 1 min (between all terminals and case)		
Noise immunity	AC voltage ±2kV the square wave noise (pulse width 1μs) by noise simulator		
Vibration	AC/DC voltage ±500V the square wave noise (pulse width 1μs) by noise simulator		
Shock	Mechanical 0.75mm amplitude at frequency 10 to 55Hz (for 1 min) in each X, Y, Z direction for 1 hour		
Environment	Mechanical 0.5mm amplitude at frequency 10 to 55Hz (for 1 min) in each X, Y, Z direction for 10 minutes		
Protection structure	Mechanical 300m/s <sup>2</sup> (approx. 30G) in each X, Y, Z direction for 3 times		
Approval	Malfunction 100m/s <sup>2</sup> (approx. 10G) in each X, Y, Z direction for 3 times		
Weight	Ambient temp. -10 to 55°C, storage: -25 to 65°C		
	Ambient humi. 35 to 85%RH, storage: 35 to 85%RH		
	IP20 (front part, IEC standard)		
	CE, RoHS		
	Approx. 130g (approx. 90g) / Approx. 120g (approx. 80g)		

※ 1: The weight includes packaging. The weight in parenthesis is for unit only.  
※ Environment resistance is rated at no freezing or condensation.

## Input Connection

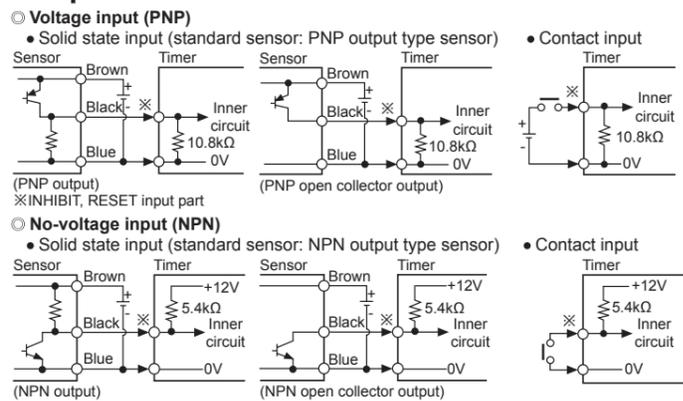


## Connections

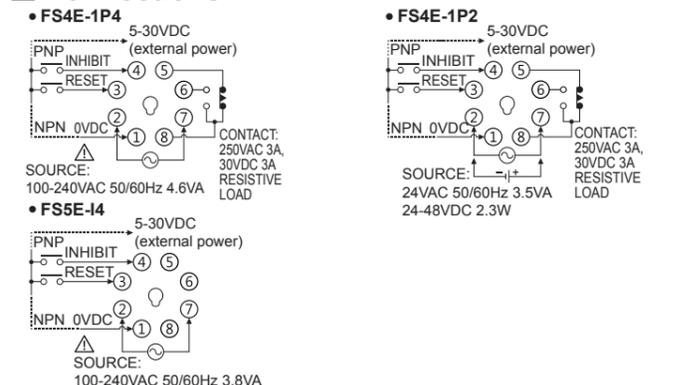


## Detaching Case

※ Turn OFF the power before detaching the case.



Push the grooves at both side of the unit with a flat head driver to the outside and push the plug part to the front. The plug is detached.  
⚠ Be sure not to be wounded when using a tool.

## DIP Switch Setting

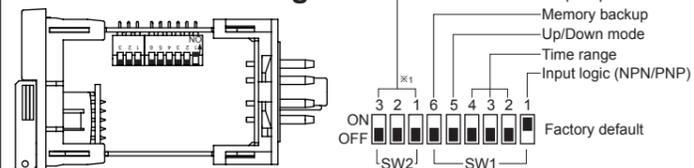

※ 1: Indicator model (FS5E-14) does not have no. 1, 2, 3 of SW2 for output operation mode setting.

SW1	Function
ON	NPN (no-voltage input)
OFF	PNP (voltage input)

SW1	Function
ON	Down mode
OFF	Up mode


※ How to change settings  
Power OFF → change settings → power ON → press [RESET] key or input signal (min. 20ms)

## Output Operation Mode

Output mode (SW2)	ON	OFF	Operation
F	Up mode	Down mode	After time-up, the display value increases or decreases until reset signal input is applied and self-holding output is maintained.
N	Up mode	Down mode	After time-up, the display value and self-holding output are maintained until reset signal input is applied.
C	Up mode	Down mode	When time-up, the display value is reset and it operates simultaneously.
R	Up mode	Down mode	After time-up, the display value is reset after one-shot output time and it operates simultaneously.
K	Up mode	Down mode	After time-up, the display value increases or decreases until reset signal input is applied.
P	Up mode	Down mode	After time-up, the display value is maintained while output is ON. The value is internally reset and it operates simultaneously.
Q	Up mode	Down mode	After time-up, the display value increases or decreases during one-shot output time.
S	Up mode	Down mode	Output turns OFF → ON → OFF repeatedly (flicker).

※ Set one-shot output time by front TIME volume switch.


## Dot for Hour, Min, Second

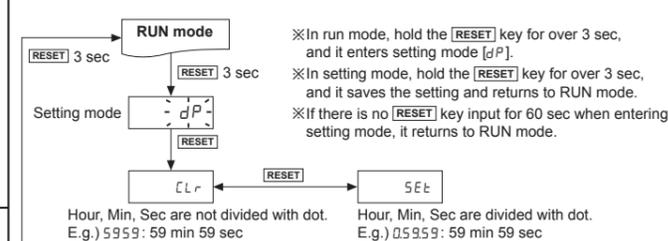

## Time Range

SW1	4-digit	5-digit	SW1	4-digit	5-digit
ON	99.99sec	9999.9sec	ON	999.9min	9999.9min
OFF	999.9sec	99999sec	OFF	99hour 59min	9hour 59min 59sec
ON	9999sec	9min 59.99sec	ON	999.9hour	999hour 59min
OFF	99min 59sec	99min 59.9sec	OFF	9999hour	9999.9hour

## Time Operation for Indicator (FS5E-14)

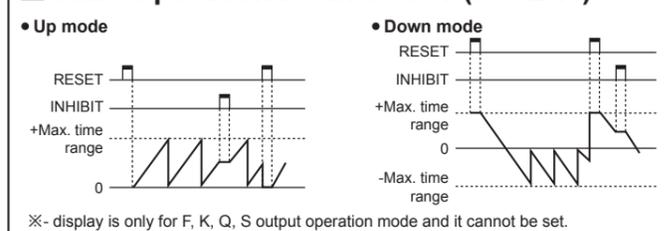

## Error Display and Output Operation

Error Display	Error description	Troubleshooting
Err0	Setting value is 0.	Change the setting value anything but 0.

## Cautions during Use

- Follow instructions in 'Cautions during Use'. Otherwise, it may cause unexpected accidents.
- 24-48VDC, 24VAC power supply should be insulated and limited voltage/current or Class 2, SELV power supply device.
- Use the product, 0.1 sec after supplying power.
- When supplying or turning off the power, use a switch or etc. to avoid chattering.
- Install a power switch or circuit breaker in the easily accessible place for supplying or disconnecting the power.
- Keep away from high voltage lines or power lines to prevent inductive noise. In case installing power line and input signal line closely, use line filter or varistor at power line and shielded wire at input signal line. Do not use near the equipment which generates strong magnetic force or high frequency noise.
- Change setting time(T1), time range or etc. after turning off the power of the timer.
- This product may be used in the following environments.
  - ① Indoors (in the environment condition rated in 'Specifications')
  - ② Altitude max. 2,000m
  - ③ Pollution degree 2
  - ④ Installation category II

## Major Products

- Photoelectric Sensors
- Fiber Optic Sensors
- Door Sensors
- Door Side Sensors
- Area Sensors
- Proximity Sensors
- Pressure Sensors
- Rotary Encoders
- Connector/sockets
- Switching Mode Power Supplies
- Control Switches/Lamps/Buzzers
- I/O Terminal Blocks & Cables
- Stepper Motors/Drivers/Motion Controllers
- Graphic/Logic Panels
- Field Network Devices
- Laser Marking System (Fiber, Co., Nd: YAG)
- Laser Welding/Cutting System
- Temperature Controllers
- Temperature/Humidity Transducers
- SSRs/Power Controllers
- Counters
- Timers
- Panel Meters
- Tachometers/Pulse (Rate) Meters
- Display Units
- Sensor Controllers

**Autonics Corporation**  
http://www.autonics.com

HEAD QUARTERS:  
18, Bongsong-ro 513 beon-gil, Haundae-gu, Busan, South Korea, 48002  
TEL: 82-51-519-3232  
E-mail: sales@autonics.com