

Multi Function Timer With Free Power, Compact Size W38×H42mm

■ Features

- Wide power supply range
: 100-240VAC 50/60Hz, 24-240VDC (universal),
24VAC 50/60Hz / 24VDC (universal), 12VDC
- Various output operations (6 operation modes)
- Multi time range (12 types of time range)
- Wide time setting range (0.1 sec to 30 hour)
- Close and DIN rail mounting
with the dedicated socket (PS-M8) width 41mm
- Easy mounting and installation/maintenance
with the dedicated bracket for DIN 48×48mm



⚠ Please read "Caution for your safety" in operation manual before using.



■ Ordering Information

ATS	8	-	4	1	
					Time range
				1	Time range 1 (0.1 to 1)
				3	Time range 3 (0.3 to 3)
					Power supply
				1	12VDC
				2	24VAC / 24VDC
				4	100-240VAC / 24-240VDC
					Number of plug pins
				8	8-pin plug type
					Item
				ATS	Small Analog Timer

※Sockets (PG-08, PS-08(N), PS-M08) are sold separately.

ATS	11	-	4	1	D
					Output
				D	Time limit 2c
				E	Instant limit 1c + Time limit 1c
					Time range
				1	Time range 1 (0.1 to 1)
				3	Time range 3 (0.3 to 3)
					Power supply
				1	12VDC
				2	24VAC / 24VDC
				4	100-240VAC / 24-240VDC
					Number of plug pins
				11	11-pin plug type
					Item
				ATS	Small Analog Timer

※Sockets (PG-11, PS-11(N)) are sold separately.

■ Specifications

Model	ATS8-□1	ATS8-□3	ATS11-□1D	ATS11-□3D	ATS11-□1E	ATS11-□3E
Function	Multi Function Timer					
Control time setting range	0.1sec to 10hour	0.3sec to 30hour	0.1sec to 10hour	0.3sec to 30hour	0.1sec to 10hour	0.3sec to 30hour
Power supply	•100-240VAC 50/60Hz, 24-240VDC universal •24VAC 50/60Hz, 24VDC universal •12VDC					
Allowable voltage range	90 to 110% of rated voltage					
Power consumption	•Max. 4.2VA (100-240VAC 50/60Hz) , Max. 2W (24-240VDC) •Max. 4.5VA (24VAC 50/60Hz), Max. 2W (24VDC) •Max. 1.5W (12VDC)		•Max. 3.5VA (100-240VAC 50/60Hz) , Max. 1.5W (24-240VDC) •Max. 4VA (24VAC 50/60Hz), Max. 1.5W (24VDC) •Max. 1W (12VDC)		•Max. 4.2VA (100-240VAC 50/60Hz) , Max. 2W (24-240VDC) •Max. 4.5VA (24VAC 50/60Hz), Max. 2W (24VDC) •Max. 1.5W (12VDC)	
Return time	Max. 100ms					
Min. input signal width	START	—		Max. 50ms	—	
	INHIBIT	—			—	
	RESET	—			—	
Input	START	—		No-voltage input - Short-circuit impedance: Max. 1kΩ, Residual voltage: Max. 0.5V Open-circuit impedance: Max. 100kΩ		
	INHIBIT	—				
	RESET	—				
Time operation	Power ON Start		Signal ON Start			
Control output	Contact type	Time limit DPDT (2c) or Instantaneous SPDT (1c)+Time limit SPDT (1c) selectable by output operation mode		Time limit DPDT (2c)		Time limit SPDT (1c), Instant limit SPDT (1c)
	Contact capacity	250VAC 3A resistive load				
Relay life cycle	Mechanical	Min. 10,000,000 operations				
	Electrical	Min. 100,000 operations (250VAC 3A resistive load)				

(A) Photoelectric Sensors

(B) Fiber Optic Sensors

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/ Sockets

(H) Temperature Controllers

(I) SSRs / Power Controllers

(J) Counters

(K) Timers

(L) Panel Meters

(M) Tacho / Speed / Pulse Meters

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors & Drivers & Controllers

(R) Graphic/ Logic Panels

(S) Field Network Devices

(T) Software

ATS Series

Specifications


Model	ATS8-□1	ATS8-□3	ATS11-□1D	ATS11-□3D	ATS11-□1E	ATS11-□3E
Repeat error	Max. ±0.2% ±10ms					
Setting error	Max. ±5% ±50ms					
Voltage error	Max. ±0.5%					
Temperature error	Max. ±2%					
Insulation resistance	100MΩ (at 500VDC megger)					
Dielectric strength	2000VAC 50/60Hz for 1 min.					
Noise resistance	±2kV the square wave noise (pulse width 1μs) by noise simulator					
Vibration	Mechanical	0.75mm amplitude at frequency of 10 to 55Hz (for 1 min.) in each X, Y, Z direction for 1 hour				
	Malfunction	0.5mm mplitude at frequency of 10 to 55Hz (for 1 min.) in each X, Y, Z direction for 10 min.				
Shock	Mechanical	300m/s ² (approx. 30G) in each of X, Y, Z directions 3 times				
	Malfunction	100m/s ² (approx. 10G) in each of X, Y, Z directions 3 times				
Environment	Ambient temperature	-10 to 55°C, storage: -25 to 65°C				
	Ambient humidity	35 to 85%RH, storage: 35 to 85%RH				
Approval	CE cULus					
Accessory	Bracket					
Unit weight	Approx. 72g					

※Environment resistance is rated at no freezing or condensation.


Connections

ATS8


●When selecting [A], [F]
output operation mode

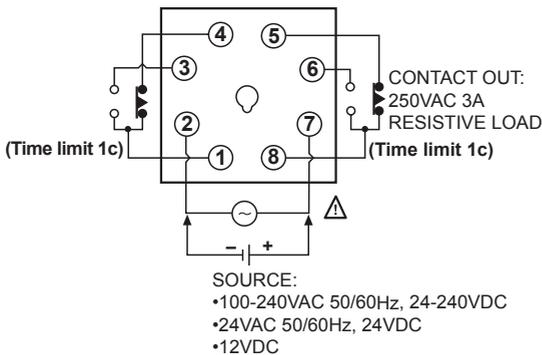


●When selecting [A1], [B], [F1], [I]
output operation mode

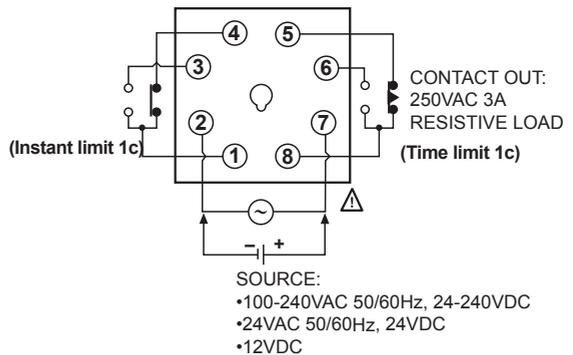

ATS11-□□D


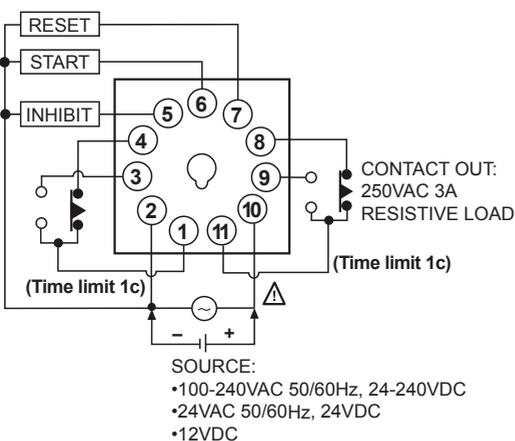


ATS11-□□E

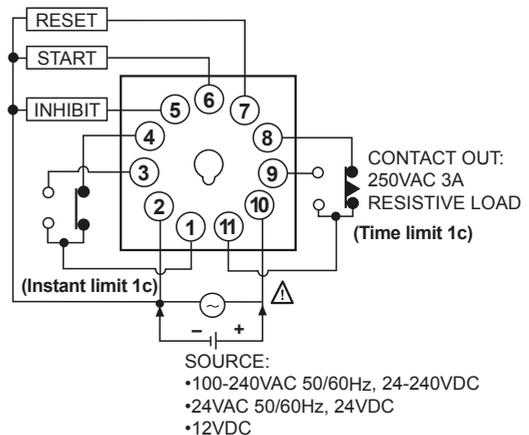


Small Multi Timer

■ Dimensions

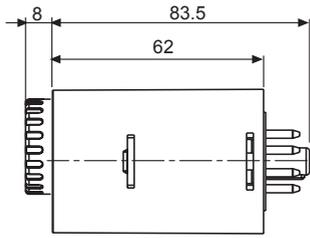


● Panel cut-out



(unit: mm)



● Bracket



8-pin socket: PG-08 (sold separately)
 ※Refer to page G-19.

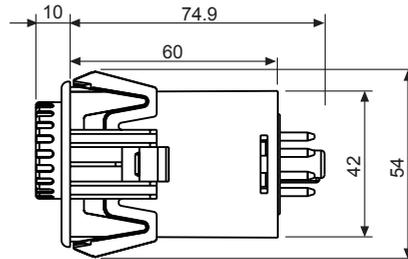

■ Unit Description


Operation/Power indication LED
 (Flashes for timer operation,
 Turns ON for timer stop)

Time setting dial

Output operation mode indicator

- ATS8
 (A, A1, B, F, F1, I mode)
- ATS11
 (A, F, F1, C, D, I mode)

Output operation mode setting SW



Output operation indication LED
 [Time limit output operation (ON): Turns ON]

Time range indication
 (1S, 10S, 1M, 10M, 1H, 10H)

Time range setting switch

※Turn the time range setting switch and the output operation mode setting switch to clockwise (CW) direction.

■ Time Range

Time range	Time unit	ATS8-□1 / ATS11-□1	ATS8-□3 / ATS11-□3
		Time range	Time range
1S	sec	0.1 to 1 sec	0.3 to 3 sec
10S		1 to 10 sec	3 to 30 sec
1M	min	0.1 to 1 min	0.3 to 3 min
10M		1 to 10 min	3 to 30 min
1H	hour	0.1 to 1 hour	0.3 to 3 hour
10H		1 to 10 hour	3 to 30 hour

■ Output Operation Mode For Each Model

●ATS8

Display	Output operation mode
A	Power ON Delay
A1	Power ON Delay 1
B	Power ON Delay 2
F	Flicker (OFF Start)
F1	Flicker 1 (ON Start)
I	Interval

●ATS11

Display	Output operation mode
A	Signal ON Delay
F	Flicker (OFF Start)
F1	Flicker 1 (ON Start)
C	Signal OFF Delay
D	Signal ON/OFF Delay
I	Interval

(A) Photoelectric Sensors

(B) Fiber Optic Sensors

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/ Sockets

(H) Temperature Controllers

(I) SSRs / Power Controllers

(J) Counters

(K) Timers

(L) Panel Meters

(M) Tacho / Speed / Pulse Meters

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors & Drivers & Controllers


(R) Graphic/ Logic Panels

(S) Field Network Devices

(T) Software


■ Output Operation Mode (ATS8)

[t : Setting time, $t > t-a$, Rt: Return time, $Rt1 > Rt$]

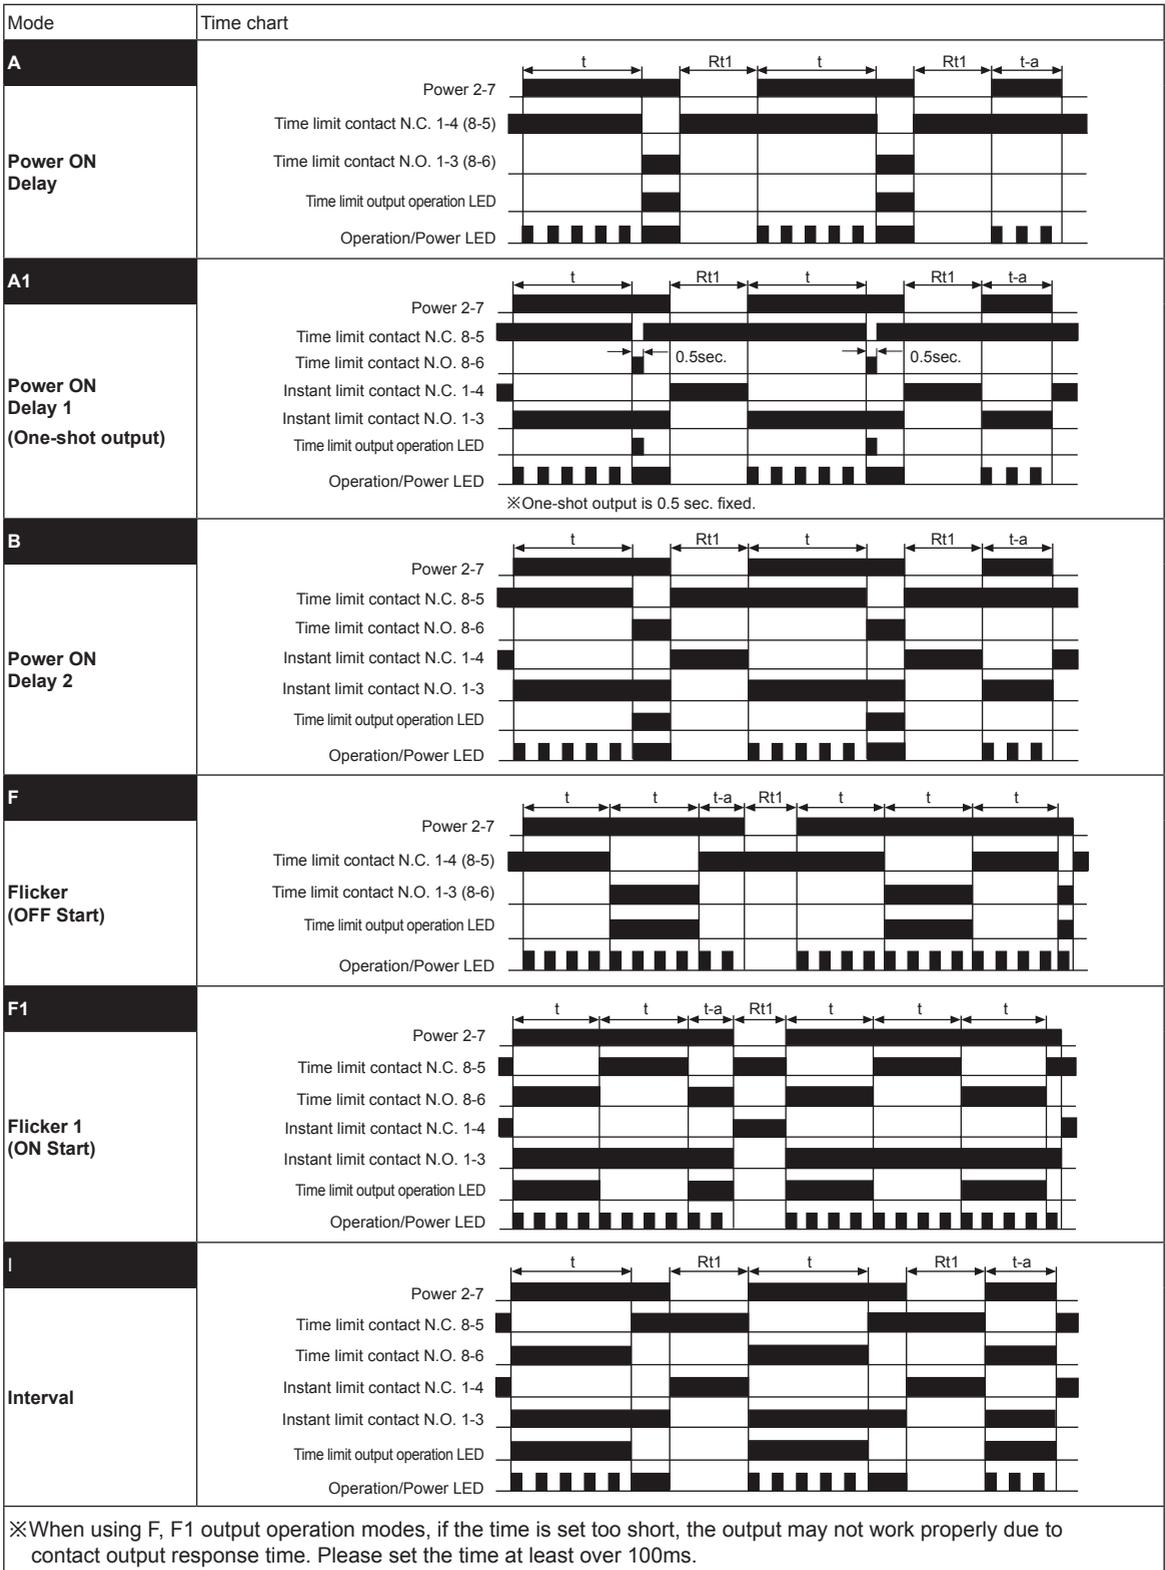

Output Operation Mode (ATS11)

[t: Setting time, $t=t_1+t_2$, $t>t-a$]

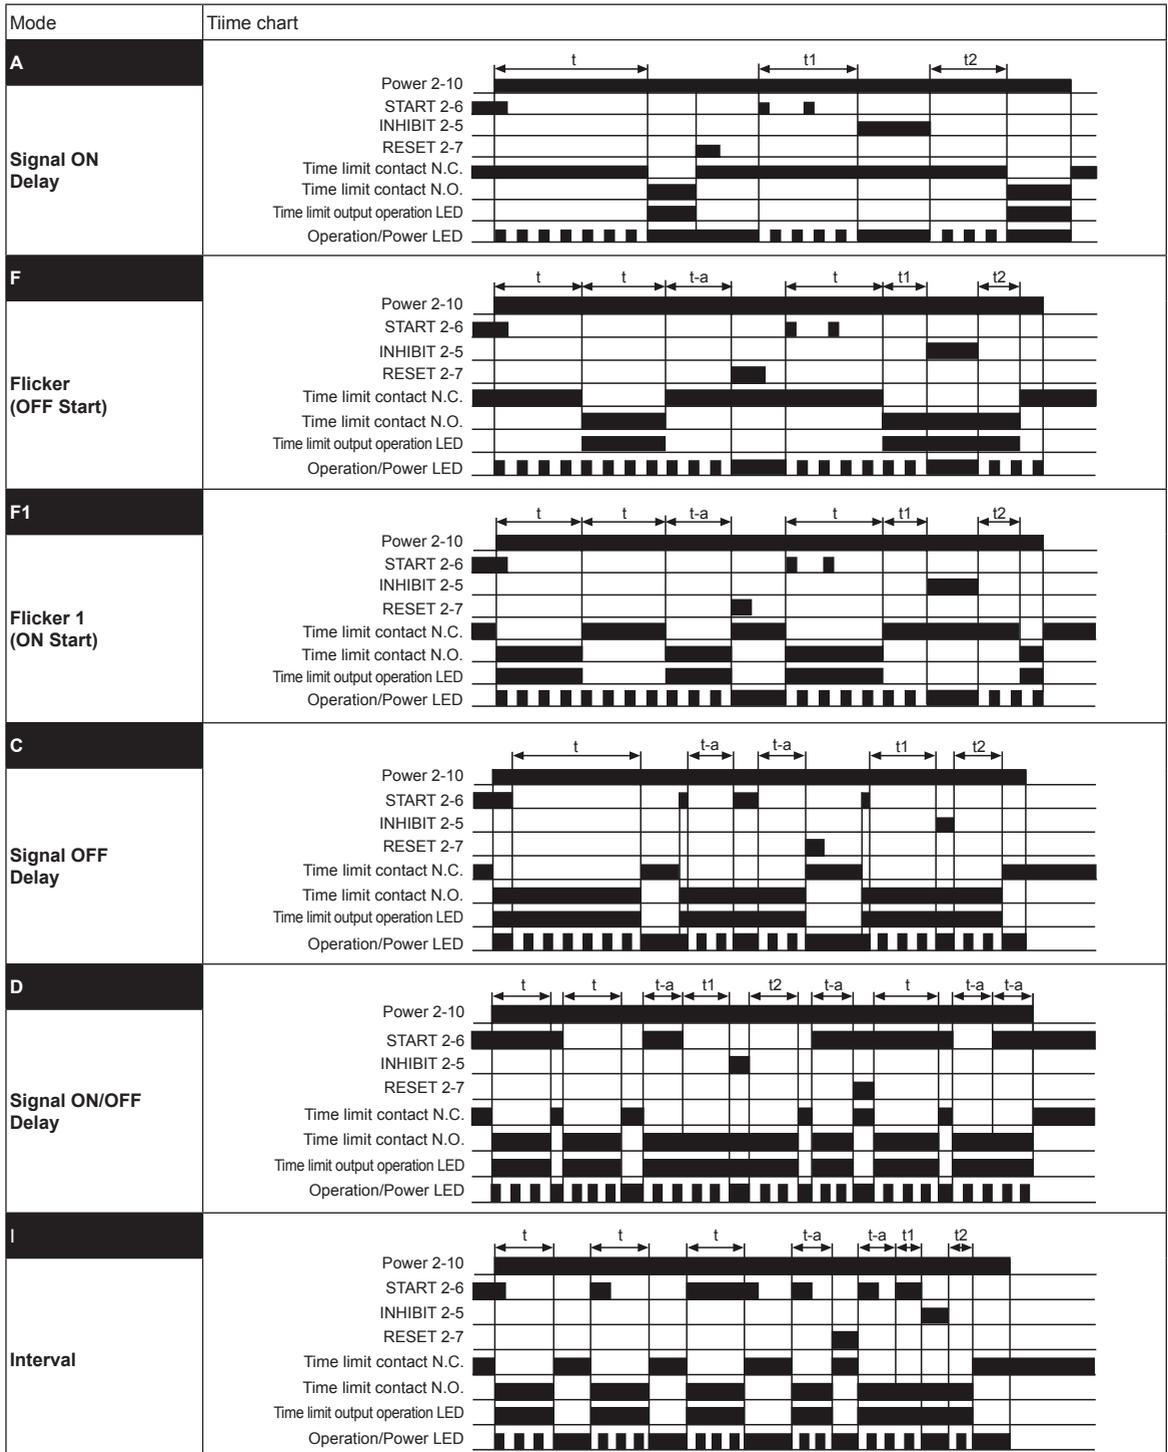


- Note) 1. If power is cut or the RESET terminal is short-circuited, the timer will be reset.
 2. If the INHIBIT terminal is short-circuited during a time limit operation, the time will stop.
 3. When using F, F1 output operation modes, if the time is set too short, the output may not work properly due to contact output response time. Please set the time at least over 100ms .

- (A) Photoelectric Sensors
- (B) Fiber Optic Sensors
- (C) Door/Area Sensors
- (D) Proximity Sensors
- (E) Pressure Sensors
- (F) Rotary Encoders
- (G) Connectors/ Sockets
- (H) Temperature Controllers
- (I) SSRs / Power Controllers
- (J) Counters
- (K) Timers
- (L) Panel Meters
- (M) Tacho / Speed / Pulse Meters
- (N) Display Units
- (O) Sensor Controllers
- (P) Switching Mode Power Supplies
- (Q) Stepper Motors & Drivers & Controllers
- (R) Graphic/ Logic Panels
- (S) Field Network Devices
- (T) Software

■ Proper Usage


○ Flicker mode

- Flicker mode which needs 3 subsidiary relays and 2 timers is available with an ATS timer.
- You can organize flicker function economically.
- Start it with a switch A and reset it with a switch B.

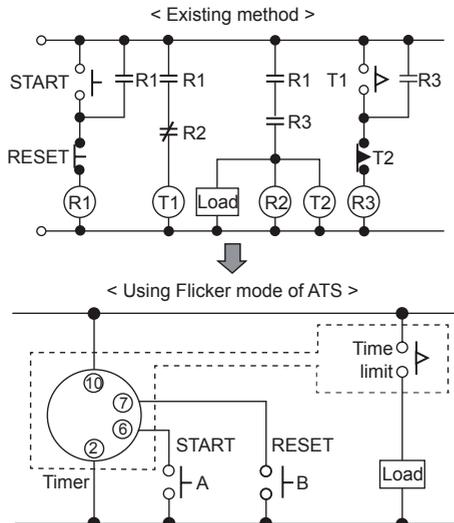

○ Interval mode

When using interval mode, you can simply organize instant limit on, time limit off (self hold circuit).

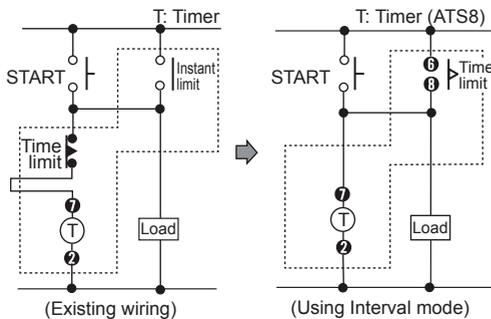

○ Conditions of input signal (ATS11-□□D, ATS11-□□E)

1. Input with contact


Use a switch which is gilded and has good reliability of contact.

Use a switch which has short bound (chattering) time for input contact because bound (chattering) time of contact timer may be error for operation time. Open resistance should be over 100kΩ and short resistance should be below 1kΩ.

※ Use contact which has good reliability to open/close for 0.4mA small current.

2. Input with NPN open collector type


Characteristics of transistor should be $V_{ce0} = \text{min. } 25\text{V}$, $I_c = \text{min. } 10\text{mA}$, $I_{cbo} = \text{max. } 0.2\mu\text{A}$, residual voltage = max. 0.5V.

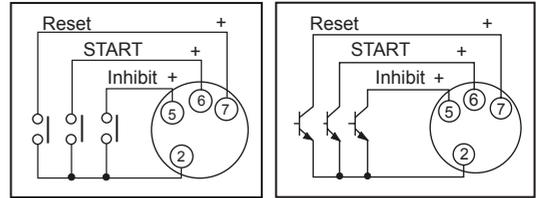

3. Input with NPN universal type

For non-contact circuit (proximity sensor, photoelectric sensor, etc.) which output voltage range is 10-30VDC, voltage output is also available as input signal not as open collector output.

In this case, when signal changes from H to L, a timer starts. Residual voltage should be below 0.5V when transistor (Q) is ON.

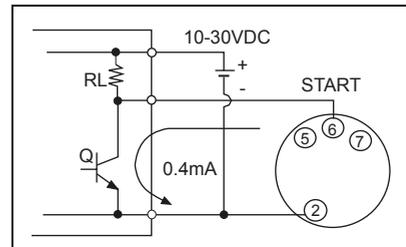

○ Terminal connection

- Refer to the connection diagrams and wire it correctly.
- Power connection

For power connection of ATS Series, when it is AC power, connect it to the designated power terminal regardless of polarity. When it is DC power, be sure the polarity for connecting.

Power voltage	8-pin type	11-pin type
AC type	Terminal ② - ⑦	Terminal ② - ⑩
DC type	Terminal ② - ⊖	Terminal ② - ⊖
	Terminal ⑦ - ⊕	Terminal ⑩ - ⊕


- Turn OFF a power switch and be sure not to supply induced voltage, residual voltage between timer power terminals. (When wiring power cable parallel with high voltage line, power line, induced voltage may occur between power terminals.)
- For DC power, ripple should be below 10% and power voltage should be within the allowable range.
- Use contact such as switch, and relay, etc. to supply power voltage at once. If supplying power slowly, its time may be up regardless of set value or power may be not reset.
- Load for control output should be below the rated load capacity.

◎ Changing of set time, time range, operation mode


It may cause malfunction when changing set time, time range, or operation mode during timer operation. Turn OFF the power and change set time, time range, or operation mode.

◎ Input connection


- Power circuit of ATS11-□□D/ATS11-□□E timer does not use trans. Use isolation transformer which secondary part is not grounded as (Figure1) to cut off peripheral current flow for supplied power to external input devices.

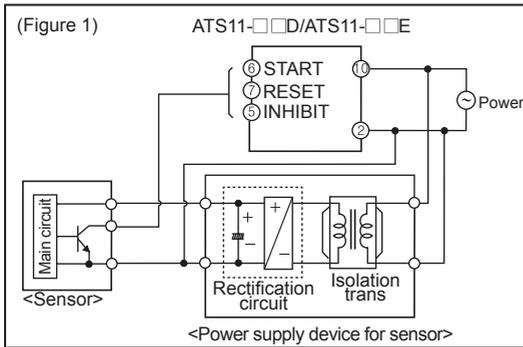

- As (Figure 2), if using terminal ⑩ as common terminal of input signal, it may cause damage to inner circuit of ATS11-□□D/ATS11-□□E timer. Use ② terminal as common terminal referring to (Figure 3).

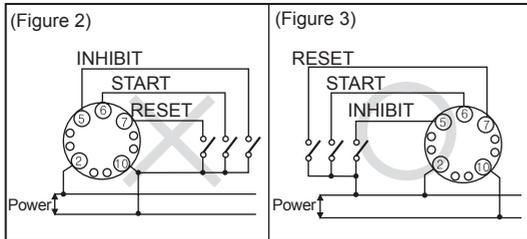


- When controlling several timers by one input contact or transistor, do not wire it as (Figure 4). This wiring causes short current due to not accorded phase of power. Wire it as (Figure 5) to accord to phase of power.

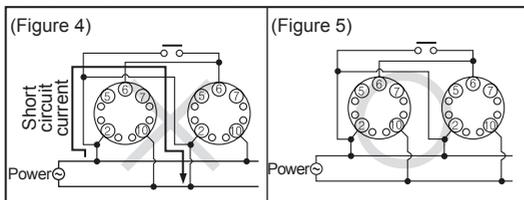

- Inhibit, Start, Reset signal is supplied to short input terminal ②-⑤, ②-⑥, ②-⑦. Be sure that if connecting other terminals or supplying over voltage, inner circuit is damaged.
- Do not wire input (START, RESET, INHIBIT) cable parallel with or the same with high voltage line, power line.
- Use shield cable when input (START, RESET, INHIBIT) cable is longer. Cable length should be as short as possible.

◎ Common

- Be sure that when using a timer at high temperature for a long time, it may cause deterioration for inner parts (electrolytic condenser, etc.).
- When supplying the power to timer, do not wire it as (Figure 6). This wiring causes timer malfunction due to path of peripheral leakage current from resistance and condenser. Connect resistance and condenser as (Figure 7) to prevent from timer malfunction by peripheral leakage current.

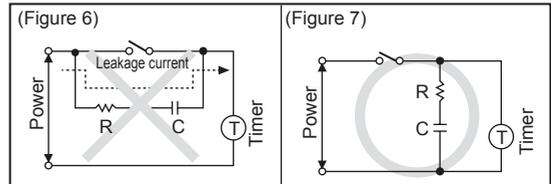

- Do not use this unit at below places.
- Place where temperature or humidity is out of the rated specifications.
- Place where there is condensation by temperature changes.
- Place where there is flammable gas or corrosive gas.
- Place where there is dust, oil or severe vibration or impact.
- Place where strong alkalis or acids is used.
- Place where there is direct ray of the sun.
- Place where strong magnetic field or electric noise is generated

(A)	Photoelectric Sensors
(B)	Fiber Optic Sensors
(C)	Door/Area Sensors
(D)	Proximity Sensors
(E)	Pressure Sensors
(F)	Rotary Encoders
(G)	Connectors/ Sockets
(H)	Temperature Controllers
(I)	SSRs / Power Controllers
(J)	Counters
(K)	Timers
(L)	Panel Meters
(M)	Tacho / Speed / Pulse Meters
(N)	Display Units
(O)	Sensor Controllers
(P)	Switching Mode Power Supplies
(Q)	Stepper Motors & Drivers & Controllers
(R)	Graphic/ Logic Panels
(S)	Field Network Devices
(T)	Software